





注意事项

1、请远离强磁场、高温、潮湿等环境；



落在地上或使之受到强力冲击；

2、不要将设备

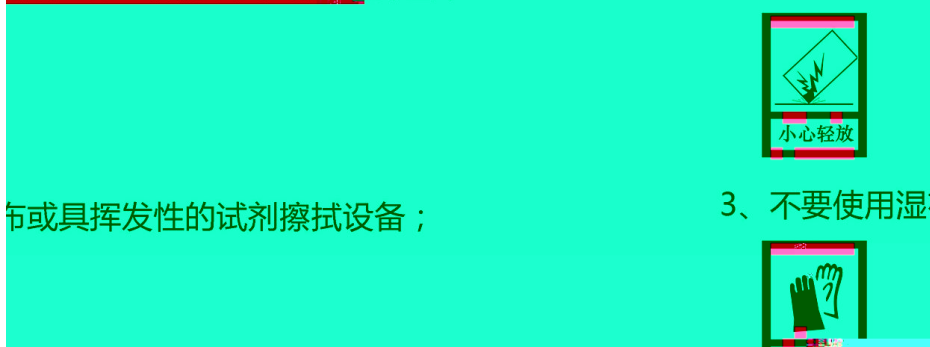

布或具挥发性的试剂擦拭设备；

3、不要使用湿



1.1.		1
1.2.		2
2.1.		3
2.2.		4
2.3.		5
3.1.		7
3.2.		10
3.3.		11
4.1.		13
4.2.		14
4.3.	&	14
4.4.		15
4.5.		16
5.1.		17
5.1.1.		17
5.1.2.		19
5.1.3.		24
5.1.4.		27
5.1.5.		27
5.1.6.		27
5.2.		28
5.2.1.		28
5.2.2.		28
5.2.3.		29
5.2.4.		30
5.2.5.		30
5.2.6.		31

6.1.		32
6.2.		33
6.3.		34

•
•
•

•

•
•
•
•
•
•
•
•
•
•

Linux
512MB
20000

CPU 2 x Cortex-A7 1.2GHz 32K
8GB

DC 18~30V
700mA DC24V
-30°C - +70°C

150mA DC24V
-40°C - +70°C
≤ 95%


CMOS
FOV H 61 V 35
850nm+


200W+200W
4.3mm
≤0.15Lux/F2.0


LCD
480×272

4.3"


(W/H/D) 130 308 26.5 mm

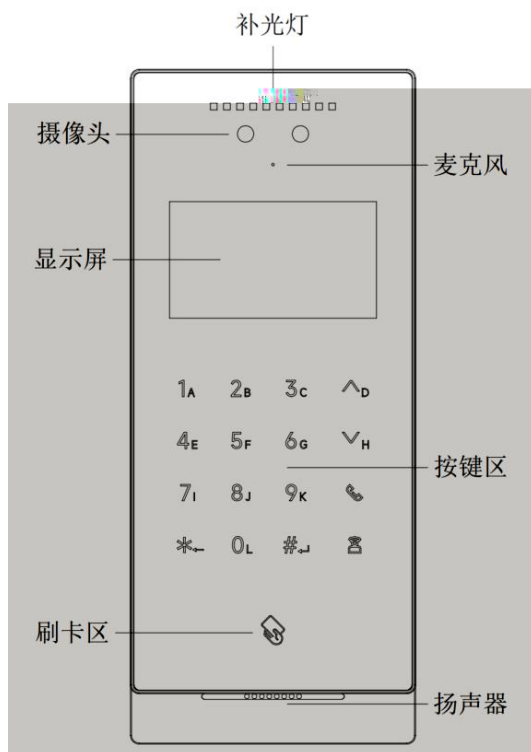

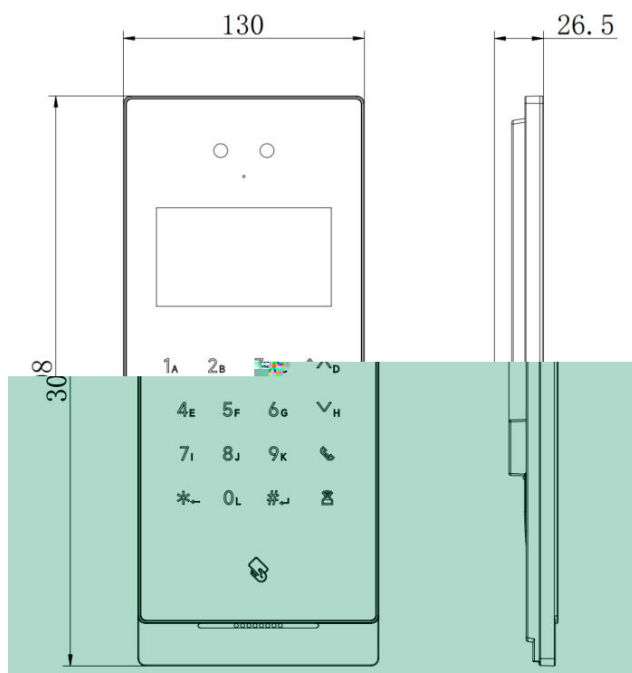

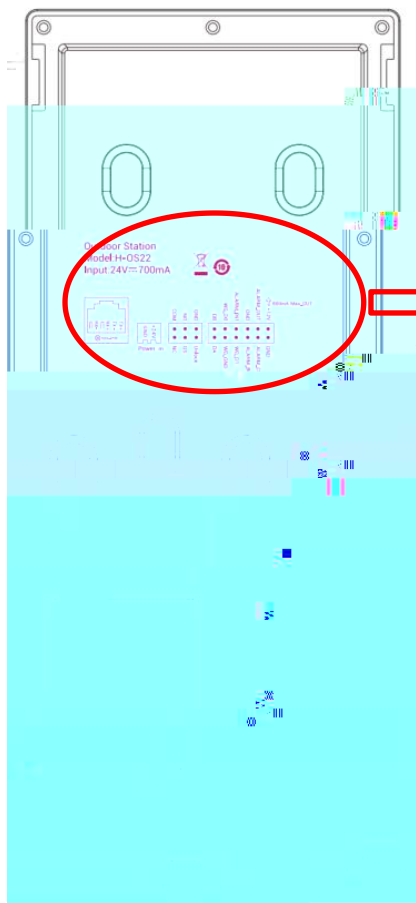





Outdoor Station
Model:H-OS22
Input:24V $\pm$ 700mA

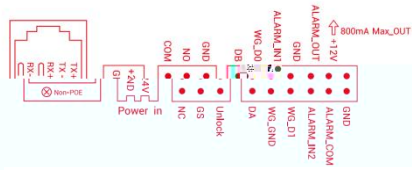


	RJ45	
	DC 24V	DC 18~30V
	COM NO NC GS UNLOCK GND	
	WG-GND WG-D0 WG-D1 DA DB 485	


ALARM_IN1	1
ALARM_IN2	2
GND	GND
ALARM_OUT	Lock2
ALARM_CO	1 3


1

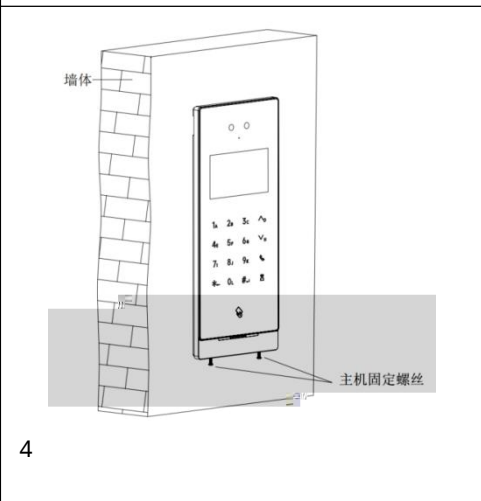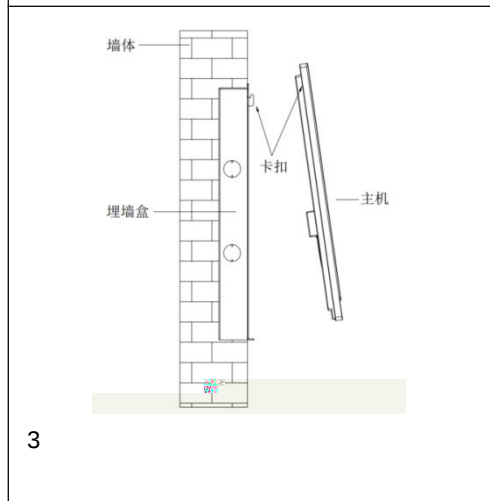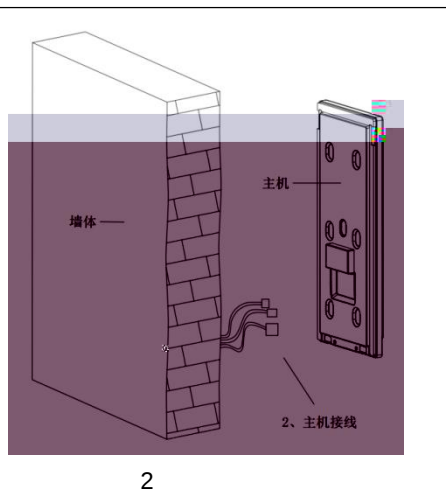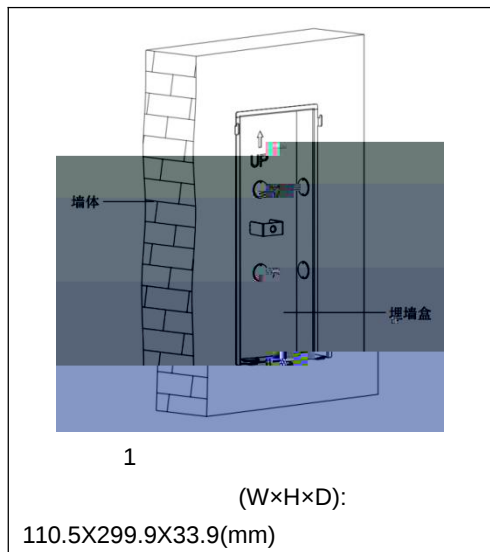


2

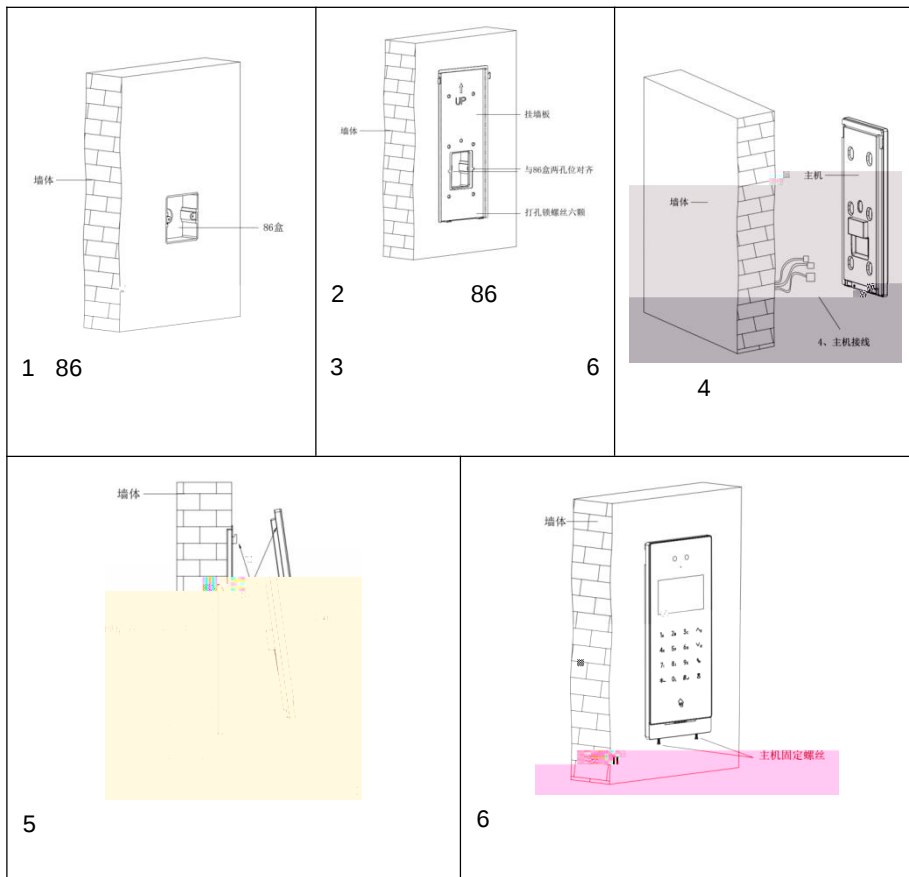

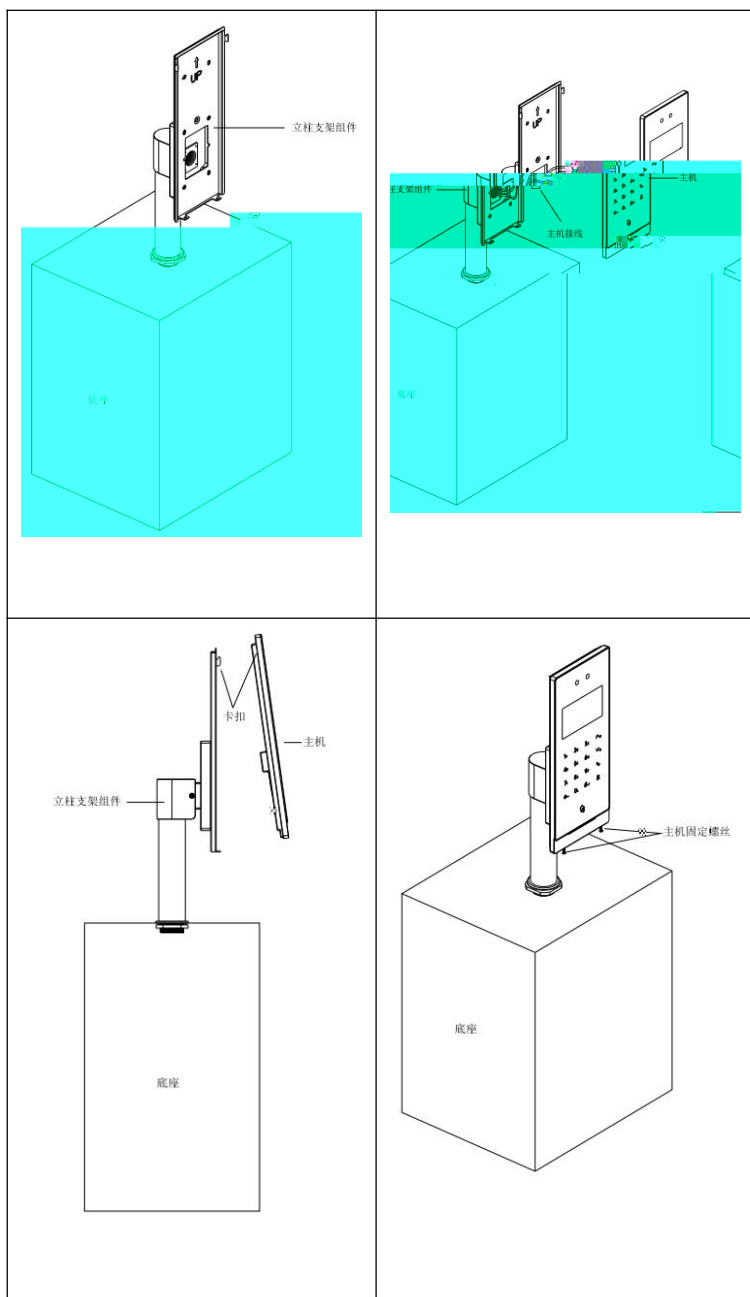


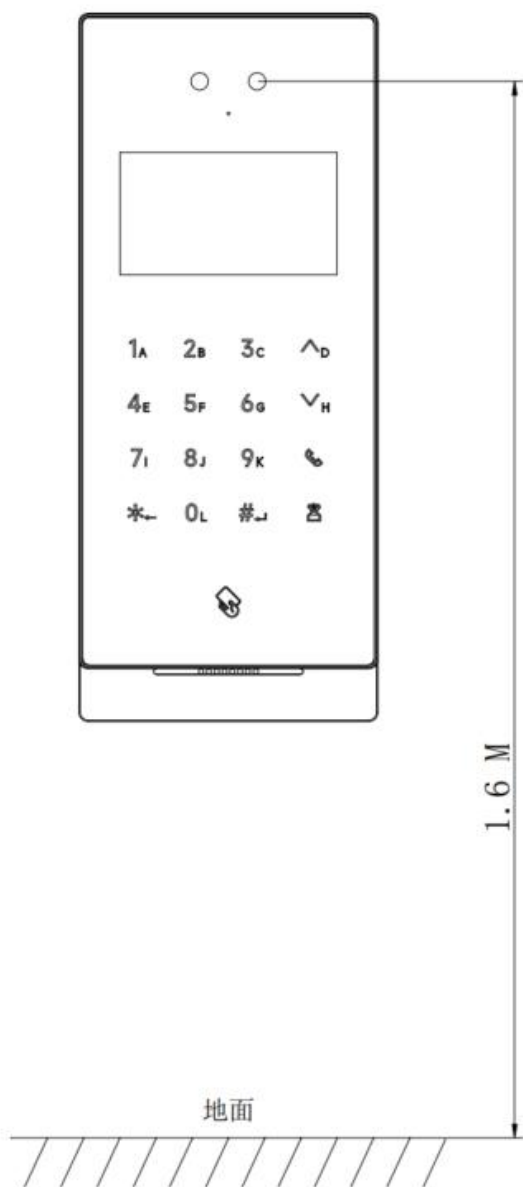


1.6

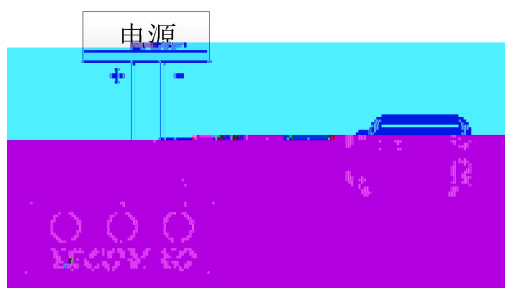

800mA
 Lock1 Lock2 - -Lock2

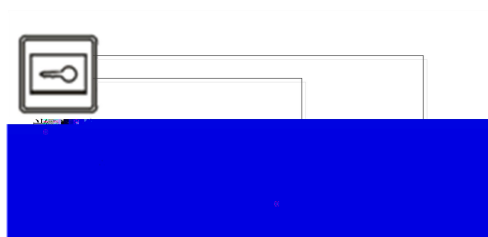

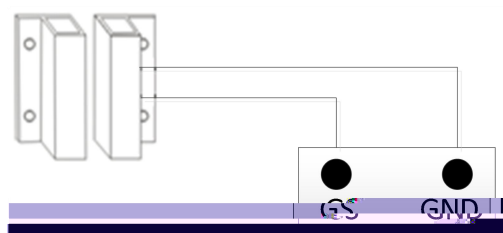

GS

60s

ip + 8103

10.0.0.1:8103



(1)



(2)



(3)



(4)



/



30s



(1)



(1)



/



16:55

1栋-1单元

请输入房号

* 返回

呼叫

(2)

/

/

- - -

30s

/



801801



(1)



(2)



(3)



(4)

1~5

5

(5)

1~5

5

(6)

1~5

5



(1)

(2)

#.

/ / / /



(1)

(2)

(3)

&

APP

(4)

/

(5)

/

公共密码设置

旧密码

新密码

确认新密码


保存

&

&

5 ~30



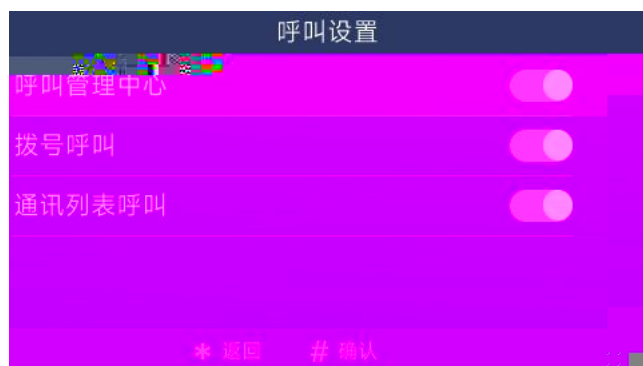

(1)



(2)

- -

(3)



(1)

(2)

(1)

(2)



20000

#

“

”


#

#

#

(1)

(2)

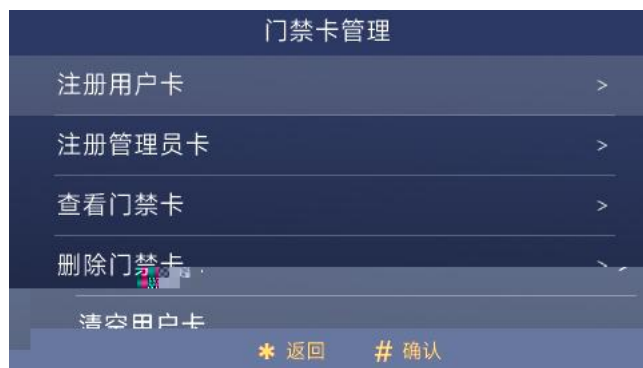

20000

/ #

#

#

/



(1)



(2)

-8 ~64 0



(1)

(2)

(3)

120

(4)

数据同步

1 — 2 — 3 — 4

门口机

围墙机

* 返回

下一步

数据同步

1 — 2 — 3 — 4

所属区域

1

栋

单元

设备编号

* 上一步

↕ 输入框切换

下一步

数据同步

1 — 2 — 3 — 4

是否同步卡数据

是

否

* 上一步

下一步

数据同步

1 2 3 4

是否同步人脸数据

是

否

* 上一步 # 开始同步

PC PC
IP

数据备份

1 2 3

本地IP地址

115

下一步

数据备份

1 2 3 4

是否备份卡数据

是

否

* 上一步 # 下一步

数据备份

1
2
3

是否备份人脸数据

是

否

* 上一步 # 开始备份

MAC

SIP

MCU

IP

SIP

关于

所属区域	2-2
设备编号	16
软件版本	H-OS22_MAIN_V0.0.6_20230717
MCU版本	H-OS22_MCU_V2.1_20230104
IP地址	10.5.128.120

* 返回

60s

60s



(1)

(2)

(3)

2m

0.3~2m



移动侦测设置

移动侦测 ☒

灵敏度设置 三级 >

是否检测到物体移动 是

* 返回 # 确认

(1)

(2)

(3)



工程密码设置

旧密码

新密码

确认新密码

保存

* 返回 # 确认



(1) 26 34

(2) Lock2 Lock2


(3) 12V 12V






(1)

(2)

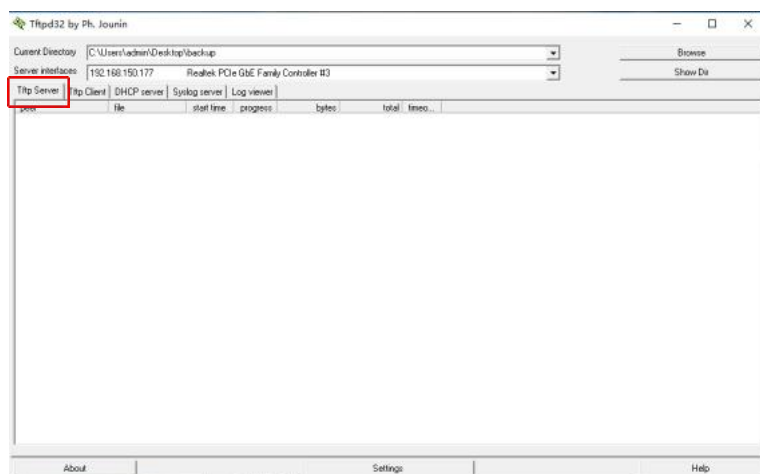

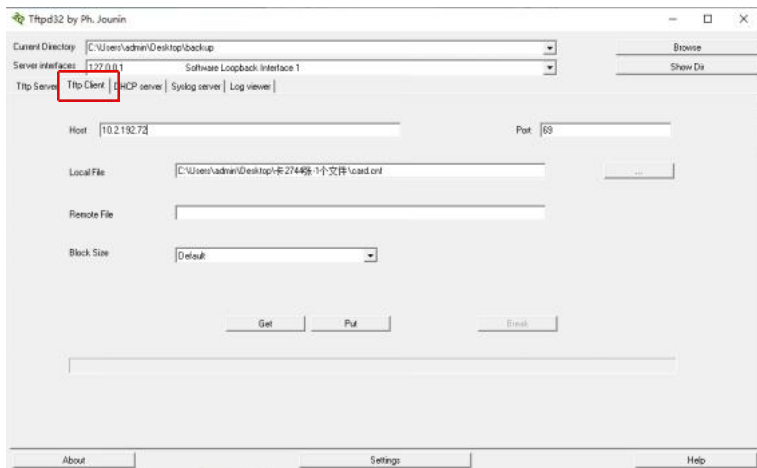

“WpfAppUpdate”

“Update Tool”

“H-OS22”

“801801”



